


Recommended minimum distances

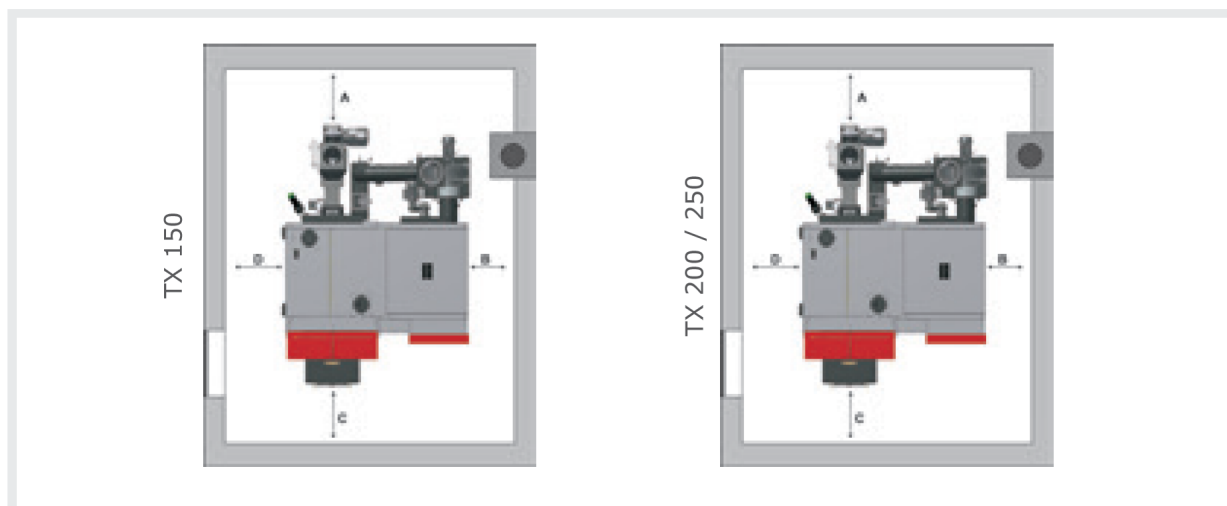

Minimum distances [mm]	TX 150	TX 200	TX 250
A Space requirement for inspection area of fuel feed-in	400	400	400
B Distance from heat exchanger side to wall	300	300	300
C Space requirement for removal of ash box	400	400	400
D Space requirement for inspection area of combustion chamber	400	400	400
Minimum room length	3,420	3,780	3,780
Minimum room width	2,670	2,770	2,770
Minimum room height	2,370	2,370	2,370
Minimum clearance for installation (WxH)	1,000 x 1,950	1,000 x 1,950	1,000 x 1,950