


Minimum distances in the boiler room

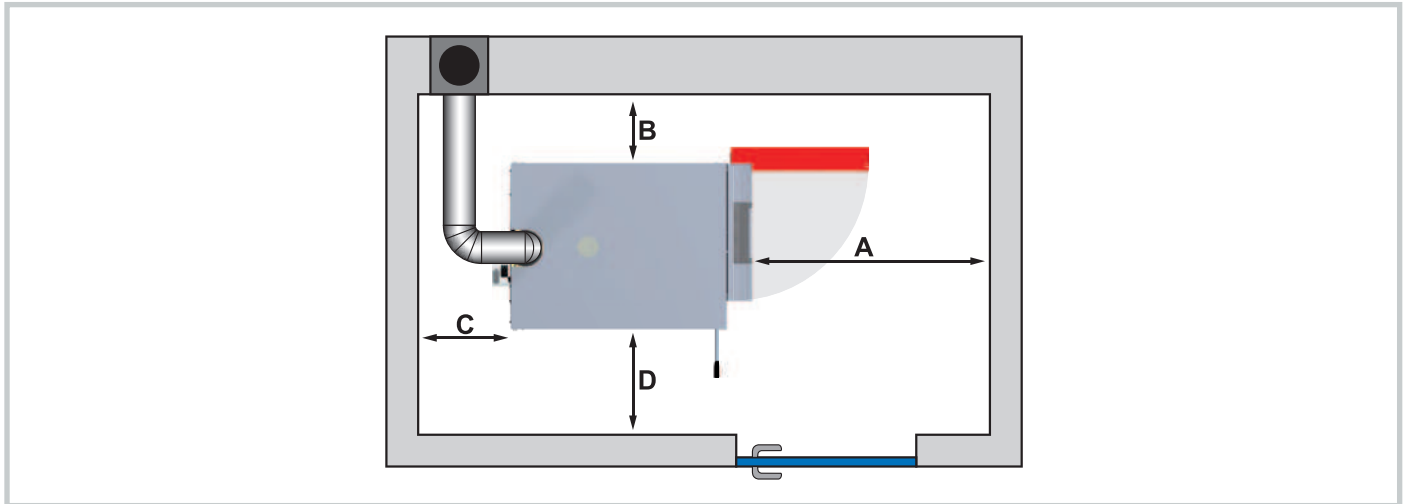

Minimum distances - S1 Turbo		15	20
A	Distance between front of boiler and wall [mm]	800	800
B	Distance between side of boiler and wall [mm]	200	200
C	Distance between rear of boiler and wall [mm]	400	400
D	Distance between side of boiler and wall ¹⁾ [mm]	500	500

1) In the model with optional WOS, the minimum distance on this side of the boiler is 500 mm.
 In the model without an optional WOS the following minimum distances are required: distance B 200 mm and distance D 500 mm OR distance B 500 mm and distance D 200 mm.