

Minimum distances in the boiler room

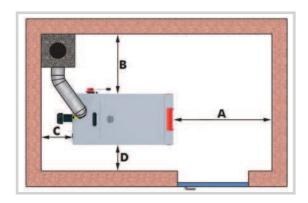

| Minimum distances - S4 Turbo | | | 15 - 60 |
|------------------------------|---|------|------------|
| А | Distance between insulated door and wall | [mm] | 800 |
| В | Distance - boiler side with WOS lever to wall | [mm] | 800 |
| С | Distance between rear of boiler and wall for S4 Turbo 15 - 40 Distance between rear of boiler and wall for S4 Turbo 40 - 60 | [mm] | 500 800 |
| D | Distance - boiler side to wall | [mm] | 200 |



| Minimum distances - S4 Turbo F | | | 15 - 60 |
|--------------------------------|---|------|---------|
| Α | Distance between insulated door and wall | [mm] | 800 |
| В | Distance - boiler side with WOS lever and pellet unit to wall | [mm] | 700 |
| В1 | Distance - boiler side without pellet unit to wall | [mm] | 1130 |
| С | Distance between rear of boiler and wall | [mm] | 500 |
| D | Distance between side of boiler and wall | [mm] | 200 |