


Minimum distances in the boiler room

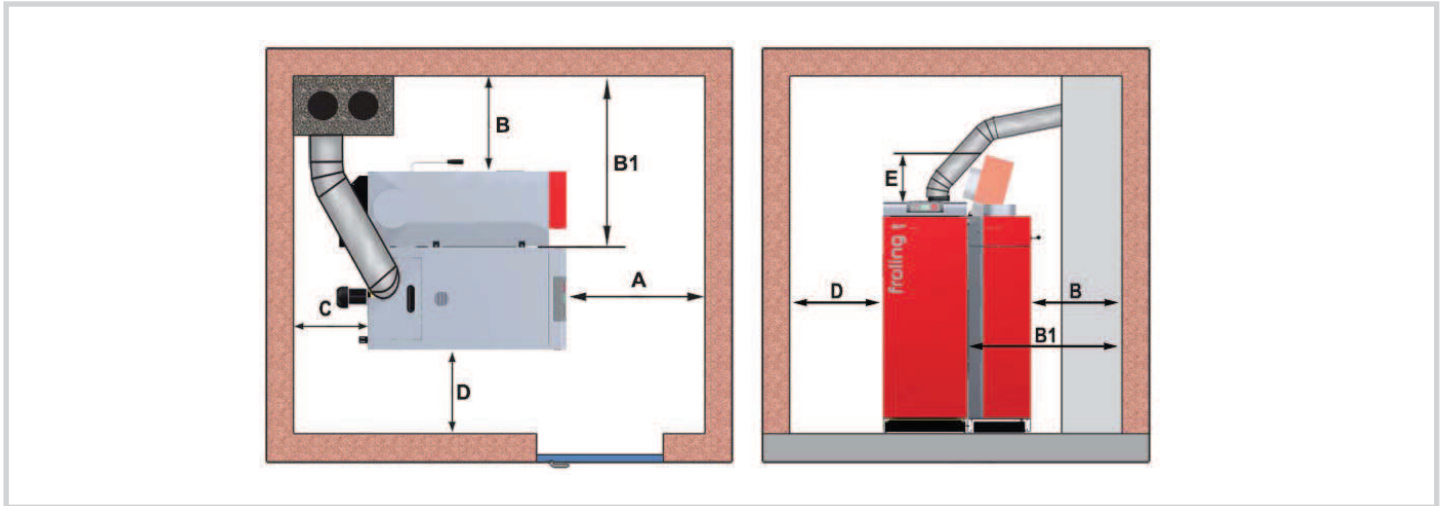

Minimum distances - SP Dual		15 / 22 / 28 / 34 / 40
A	Distance between insulated door and wall	[mm] 800
B	Distance – boiler side with WOS lever and pellet unit to wall	[mm] 700
B1	Distance – boiler side without pellet unit to wall	[mm] 1130
C	Distance between rear of boiler and wall	[mm] 500
D	Distance between side of boiler and wall	[mm] 200
E	Space required for open cover	[mm] 300